


910

- Notes:**
1. All thin-set brick shall be new brick of a full range blend.
 2. Use existing sidewalk brick supplemented with new brick in sidewalk transition areas.
 3. Existing concrete curb to be replaced in kind.
 4. Existing stone curb to be replaced with new granite curb.

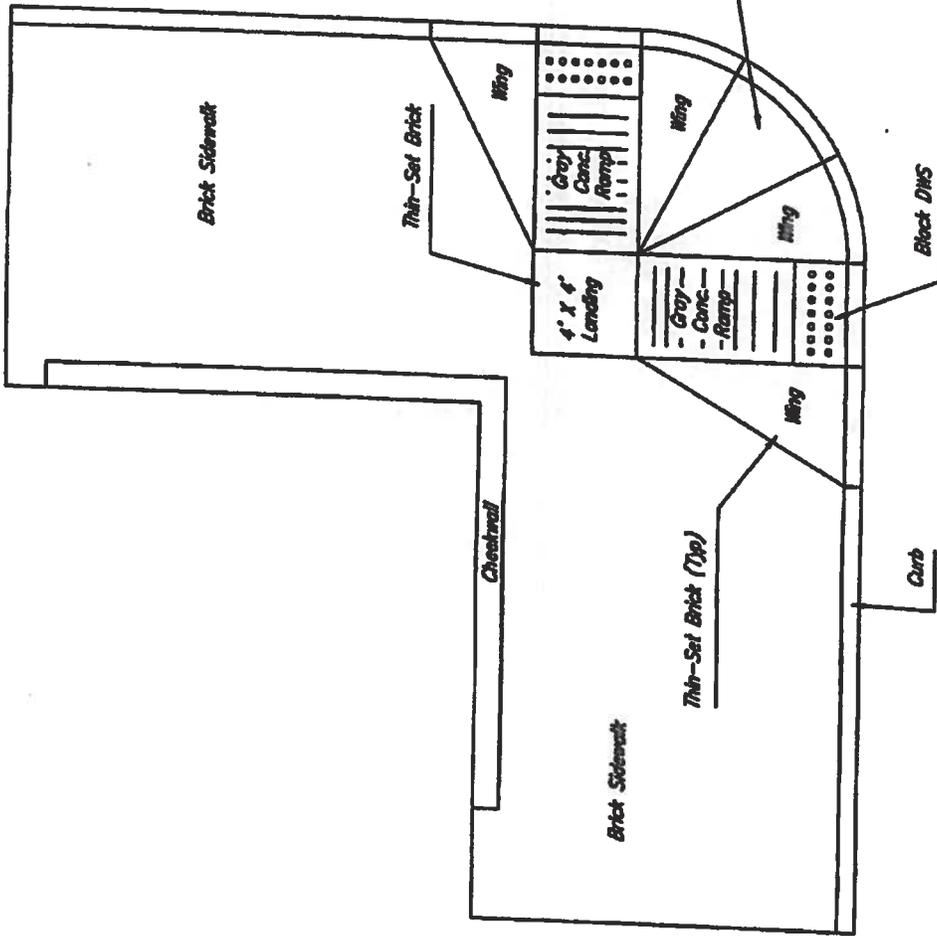

PHILADELPHIA COUNTY



ADA Curb Ramps in Brick Sidewalks

Ramp Plan

DATE: 02/13/2013

SW-ADA-01



[Signature]

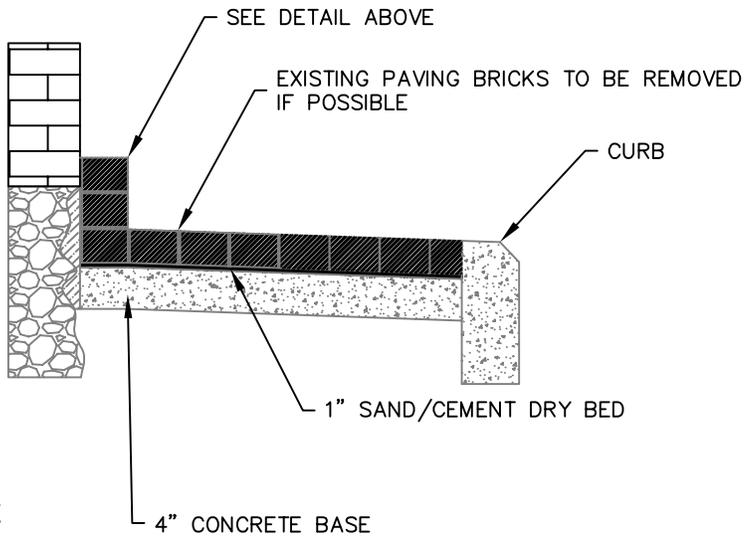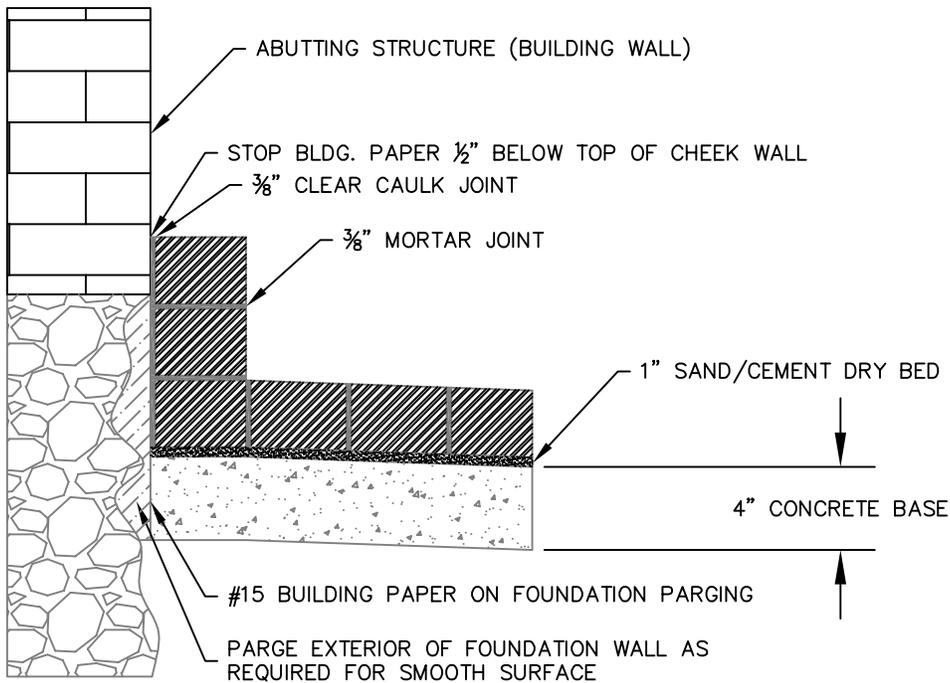

1. CHEEKWALL HEIGHT WILL VARY DEPENDING ON THE HEIGHT OF THE ABUTTING WALL. IT SHALL BE NO HIGHER THAN 2 COURSES ABOVE THE TOP OF THE FOUNDATION WALL.
2. CAULK SHOULD BE HIGH-QUALITY OIL-BASED CAULK (NON-SILICONE).
3. CANT TOP ROW OF BRICK TO SHED WATER TO FOOTWAY.

CITY OF PHILADELPHIA
DEPARTMENT OF STREETS
BRICK SIDEWALK &
CHEEK WALL SINGLE WYTHE

| | | | |
|------------------|----------|--------------|---------|
| DATE | 12/08/14 | SHEET 1 OF 1 | SC0110A |
| REVISED | 3/01/15 | | |
| APPROVED: V.L.F. | | | |

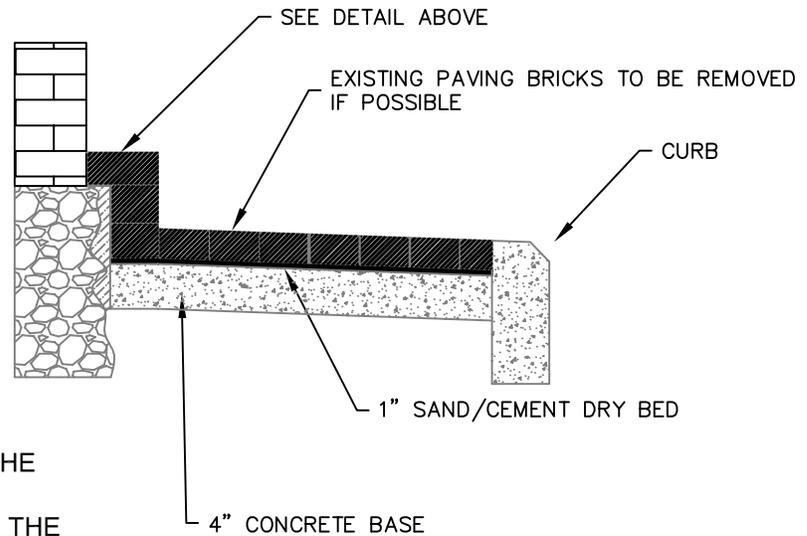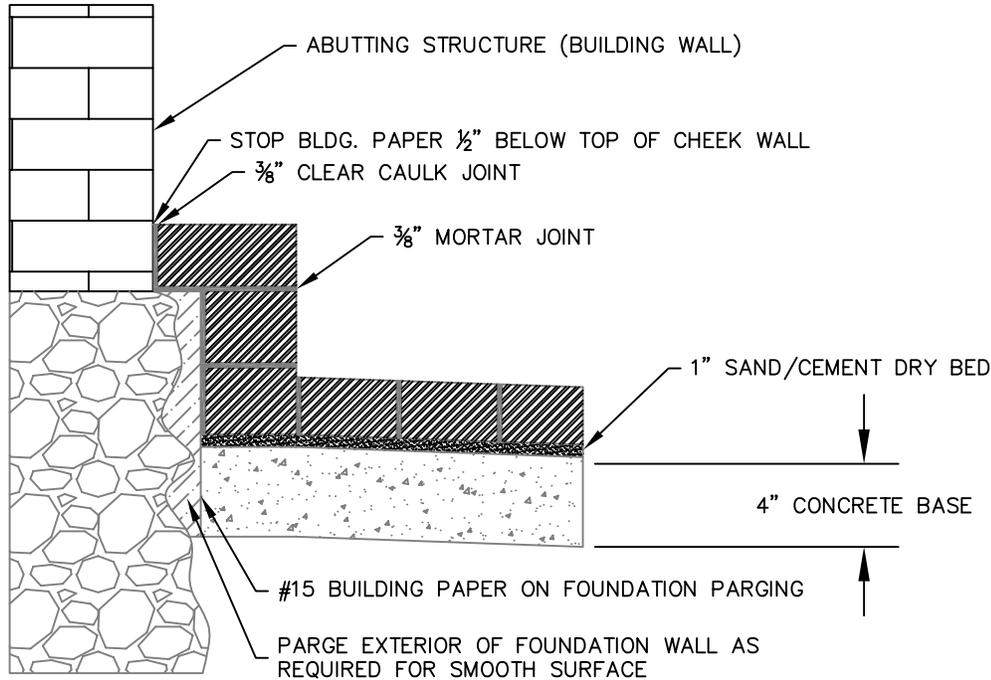

1. CHEEKWALL HEIGHT WILL VARY DEPENDING ON THE HEIGHT OF THE ABUTTING WALL. IT SHALL BE NO HIGHER THAN 2 COURSES ABOVE THE TOP OF THE FOUNDATION WALL.
2. CAULK SHOULD BE HIGH-QUALITY OIL-BASED CAULK (NON-SILICONE).
3. CANT TOP ROW OF BRICK TO SHED WATER TO FOOTWAY.

CITY OF PHILADELPHIA
DEPARTMENT OF STREETS

BRICK SIDEWALK AND CHEEK
WALL MULTIPLE WYTHE

| | | | |
|------------------|----------|--------------|---------|
| DATE | 12/08/14 | SHEET 1 OF 1 | SC0110B |
| REVISED | 3/01/15 | | |
| APPROVED: V.L.F. | | | |